



LSP /
HID VERTX
PROWIRE®



HID VERTX Pre-Wired Product Companion

Wiring Convention and Supplemental Guide to
HID VERTX ProWire™ Power Management Systems

Contents

Introduction.....	3
Standard Conventions.....	4
System Wiring Example	12
Typical Wiring - VERTX Boards	17
Typical Wiring - LSP Boards	20

Introduction

Traditional wiring for access control systems is time consuming and labor intensive. ProWire[™] systems take LifeSafety Power's award-winning Unified Power[™] solutions to a new higher level of service by pre-wiring all lock and system power connections to Authentic HID Global[™] terminal strips for easy plug-and-play installation.

Prewired features of ProWire[™] Systems include access control or system power, lock power, auxiliary power distribution, lock control, system communications loop, and optional remote management.

The access control modules are powered from a D8 power distribution module providing a fused source with individual protection for each access control board and a dedicated power supply configured for 12VDC. Each D8 module provides eight protected outputs capable of 3A per output and a configuration jumper to select which power supply is applied to a specific output in dual voltage systems.

The field connected locks are powered and controlled from either a C8 or M8 lock control module with a separate dedicated power supply typically configured for 24VDC. Each C8 or M8 module provides either jumpers or software programmability to configure each individual output for 12 or 24VDC, FAI operation, and failsafe or failsecure operation of the lock when triggered by the access control.

Optional remote management provides the system with the ability to generate email or SNMP alert messages on a scheduled or event driven basis, monitor and control power remotely, test standby batteries over the network, and maintain a historical record of system performance.

Units from four to sixteen door capacity are available with wire tie or wire duct wire management.



Standard Conventions

The following section presents the conventions used within this document for board labeling and placement, output usage, and wire coloring.

VERTX Board Numbering

VERTX board locations are numbered as V1, V2, etc. in sequence, from top to bottom, left to right or in a clockwise order, depending on enclosure and available open locations.

Configurations using a V1000 controller will always have the controller located in the V1 location.

See Typical Enclosure Configurations starting on page 5 for examples.

LSP Board Numbering

LifeSafety Power board locations are numbered with the board type and a number to indicate individual boards. Locations with multiple designations may have either board or may have both boards stacked, depending on configuration.

FPO-1 Lock Power, or System Power in Single Voltage Systems

FPO-2 System Power in large Dual Voltage Systems

B100 System Power in small Dual Voltage Systems

D8-1 to D8-n Power Distribution, Fused


C8-1 / M8-1 Lock Control for locks 1 - 8

C8-2 / M8-2 Lock Control for locks 9 - 16


VERTX Board Mounting

Mounting of the HID VERTX subassemblies are by means of the supplied 6-32 SEMS screws using the preinstalled hex standoffs.


 Do not overtighten the hardware during the install process.

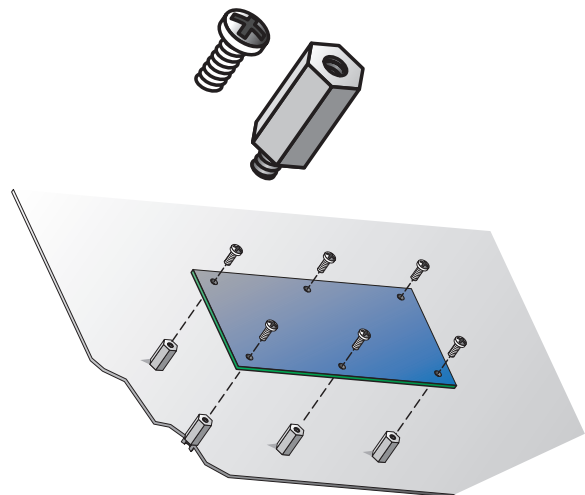


Typical System Configurations

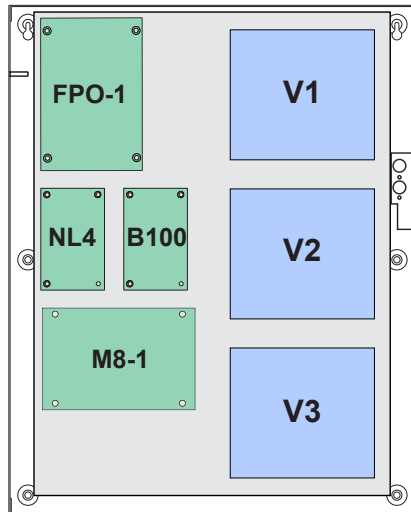

4 Door - E2V

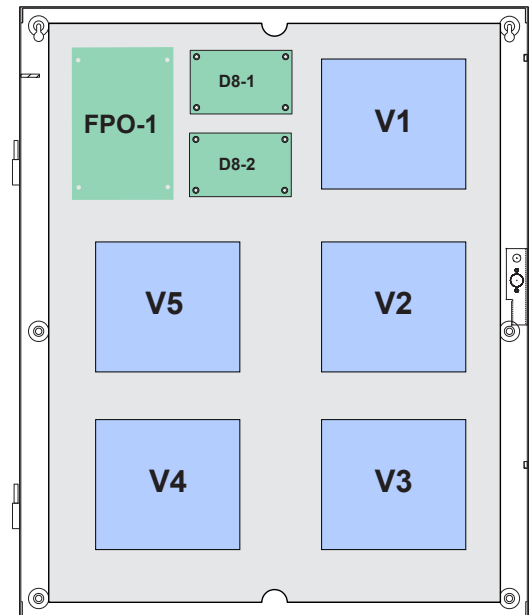


8 Door - E4V
Single Voltage

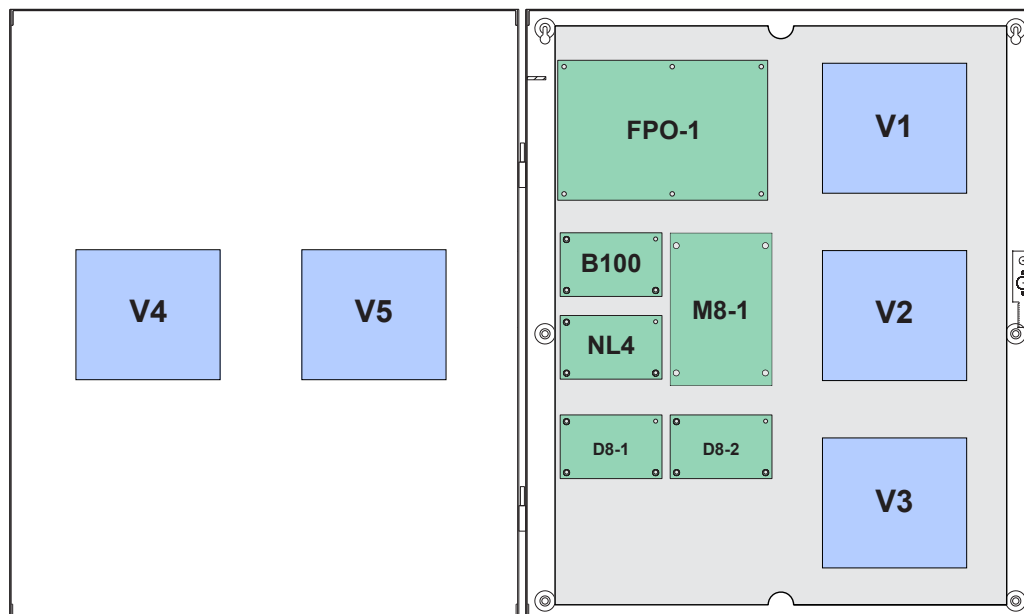

8 Door - E4V1
Dual Voltage


Typical System Configurations

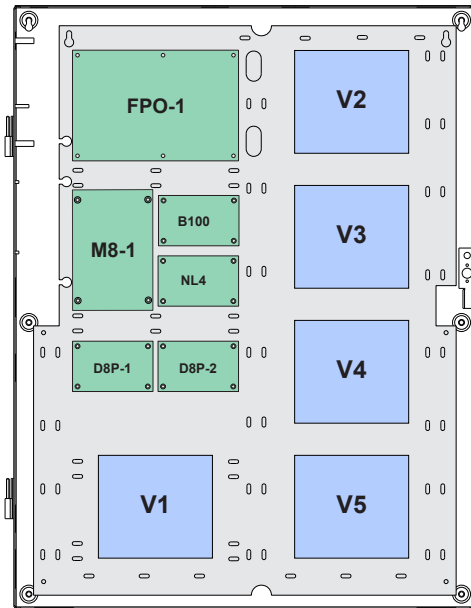

8 Door - E6V



16 Door - E8V

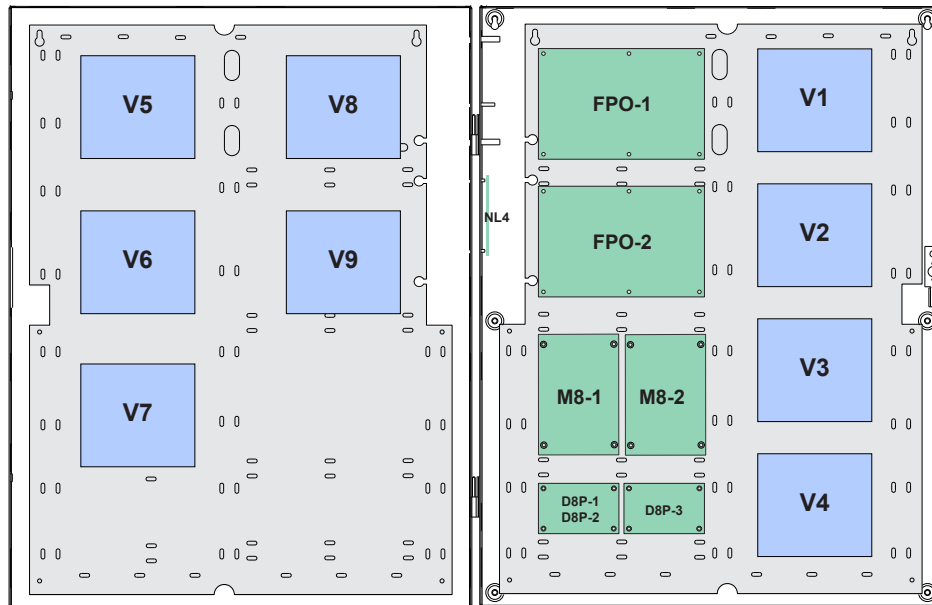

16 Door - E6V1



Power is knowledge.™

LifeSafetyPower®

LSP /
HID VERTX
PROWIRE®

This Page Intentionally Blank

Wiring Conventions

Wiring within the enclosure uses a consistent method and wire coloring as detailed below.

VERTX Board Power Connections

VERTX Board power originates from the 12V supply (FPO-2 or B100) in Dual Voltage systems, or from FPO-1 in Single Voltage systems. Power is supplied to the VERTX boards from D8-1, providing fused outputs. VERTX Board V1 is powered from D8-1 output 1, V2 from D8-1 output 2, etc. VERTX Power wiring uses twisted 22AWG wire.

Red: +12VDC

Black: Ground (-)

VERTX RS-458 Communications

The VERTX RS-485 communications wiring is daisy chained from VERTX Board V1, to V2, etc. VERTX RS-485 wiring uses jacketed, twisted 20AWG wire with shield.

White: A

Black: B

Shield: SHIELD

Lock Control Input Color Code to C8/M8 from VERTX Outputs

The wiring between the VERTX board output and the C8 or M8 Lock Control board inputs uses twisted 22AWG wire with the following color convention:

Output 1: Brown / Black

Output 2: Red / Black

Output 3: Orange / Black

Output 4: Yellow / Black

Output 5: Green / Black

Output 6: Blue / Black

Output 7: Violet / Black

Output 8: Gray / Black

Wire coloring repeats for inputs 9-16 on C8-2/M8-2

ProWire™

Standard Conventions

Quick Reference

VERTX Board Numbering

- V1 ... V2
- V3 ... V4
- V5 ... V6
- V7 ... V8
- Controller location - V1

LSP Board Numbering

- FPO1 - Lock power
- FPO2 - System power
- D8-1 to D8-n - D8 power distribution
- C8-1/M8-1 Lock control for locks 1 - 8
- C8-2/M8-2 Lock control for locks 9 - 16

VERTX Board Power

- 12VDC, Fused
- Red +12VDC
- Black GND
- Twisted 22 AWG
- From D8-1

RS-485 Communications

- Daisy chained from V1....Vn
- Jacketed, twisted, with shield, 20 AWG
- White - A
- Black - B
- Shield - SHIELD

Lock Control Input Color Code to C8 /M8 from Access Control

- 1 - Brown / Black twisted 22 AWG
- 2 - Red / Black twisted 22 AWG
- 3 - Orange / Black twisted 22 AWG
- 4 - Yellow / Black twisted 22 AWG
- 5 - Green / Black twisted 22 AWG
- 6 - Blue / Black twisted 22 AWG
- 7 - Violet / Black twisted 22 AWG
- 8 - Gray / Black twisted 22 AWG
- Repeat for inputs 9 - 16 on C8-2/M8-2



System Wiring Example

The following pages show an overview of wiring for a typical prewired system. Details of the wiring for each board are in later sections. All drawings show an “A” configuration (using a V1000 controller).

LifeSafety Power Board, Fault, and Tamper Switch Wiring

The LifeSafety Power boards are prewired for power, Fault, and FlexIO. FPO-1 is wired to the B1 buss, and FPO-2 is wired to the B2 buss. FlexIO daisychains between all of the LSP boards to provide fault and FAI throughout the system. Fault wiring uses the FPO's NO contacts for System and AC fault and connects to the V1 fault input. See AN-19 for more information on the Dual Buss architecture used for accessory power.



System Wiring Example

VERTX Board Power Wiring

The VERTX controllers are prewired for power to D8-1. VERTX board V1 is wired to output 1, V2 to output 2, etc. Wiring is red/black twisted pair. All drawings show an “A” configuration (using the V1000 controller).



System Wiring Example

VERTX Board Communication Wiring

The VERTX controller RS-485 communication between boards is prewired from V1 in order to the last board in the chain. Wiring is jacketed and twisted with shield. Black and white wires are for A and B, while the shield is used for Shield. All drawings show an “A” configuration (using the V1000 controller).



System Wiring Example


VERTX Board Output Relay Wiring

The output lock relays of the VERTX controllers are prewired to the inputs of the C8 or M8 lock control boards. Wiring is twisted pair and is color coded. All drawings show an “A” configuration (using the V1000 controller).





Typical Wiring - V1000

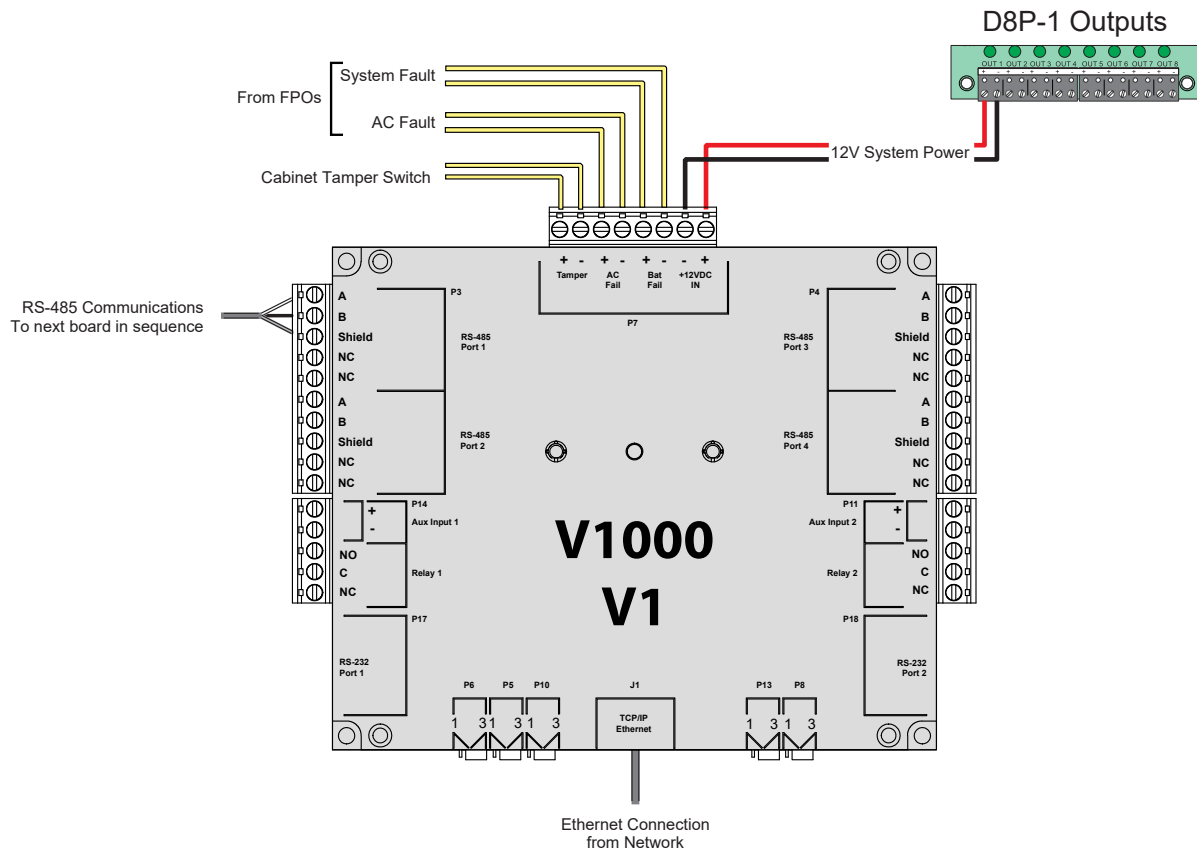

The V1000 intelligent controller provides decision making, event reporting, and database storage for the VERTX hardware platform.

Communication between connected boards is by means of RS-485. Two pairs of RS-485 ports provides connection for up to 32 connected modules.


The V1000 requires 12VDC for power and is connected to 12VDC supplied from an LSP D8 power distribution module.

Mechanical mounting is by four, supplied, 1/2" metal standoffs threaded into the enclosure backplate with the board secured to the standoffs with eight 6-32 x 3/8" machine screws.

For electrical connection, remove the appropriate terminal strips from the board and replace with the supplied, pre-wired and identified terminal strips.



Typical Wiring - V100

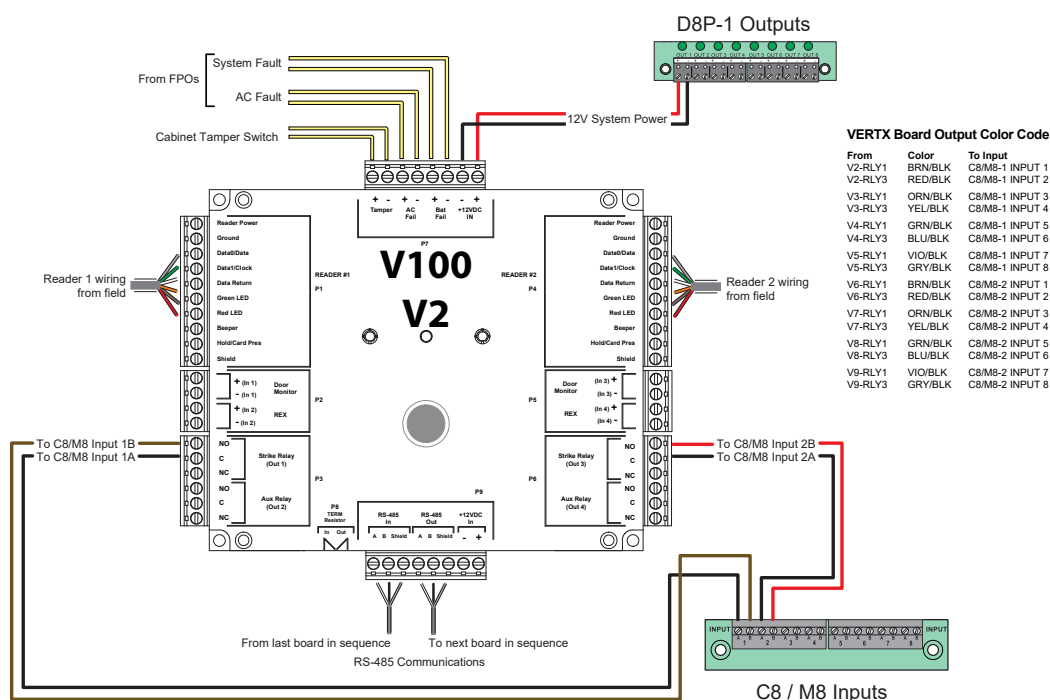

The V100 reader interface provides a solution for interfacing to readers and door hardware. The V100 can accept data from readers with clock/data, Wiegand or RS-485 signaling, and provide LED and buzzer control.

Four form-C relay outputs may be used for door control or alarm signaling. Four supervised inputs are provided for monitoring the door contact, and exit push button.


Communication to the V100 is accomplished via a 2-wire RS-485 interface.

The V100 requires 12VDC for power and is connected to 12VDC supplied from an LSP D8 power distribution module.

The lock outputs of the V100 are connected to the C8/M8 inputs such that the V100 activates the C8/M8 lock control board and the C8/M8 activates the lock. This method adds another layer of control to the lock and protection for the VERTX hardware.



Typical Wiring - FPO150 / FPO250

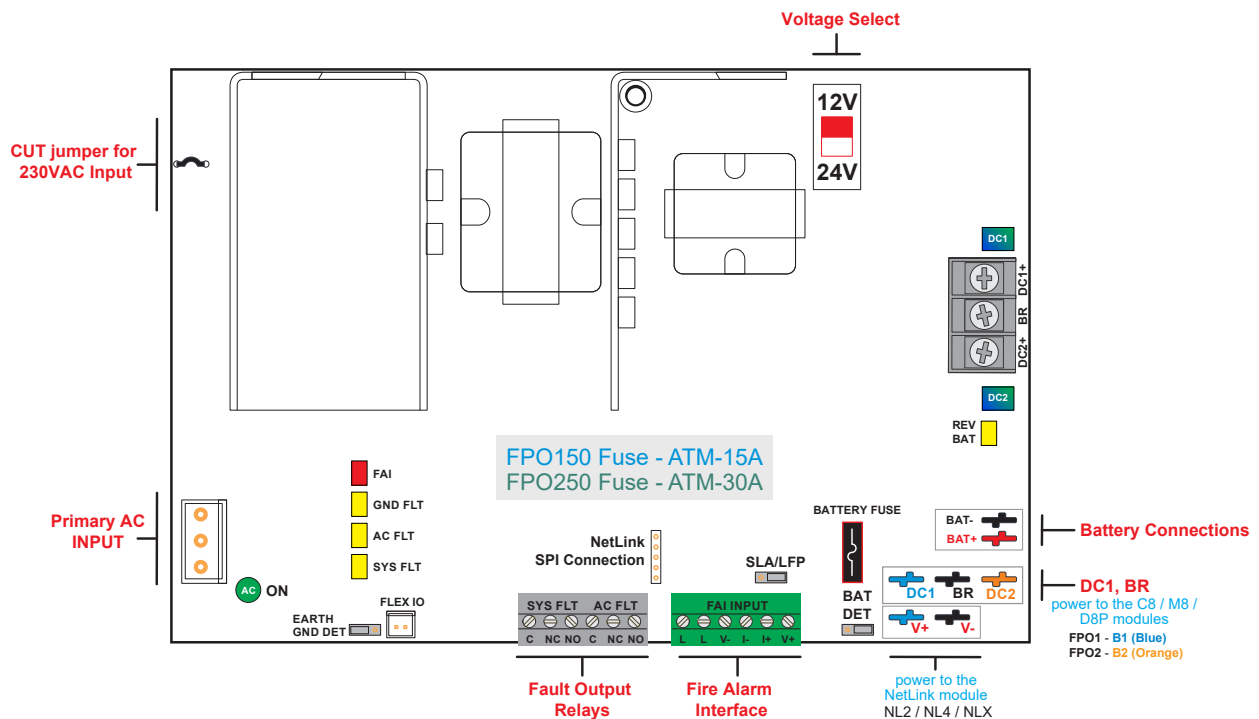


The FPO150 will provide 12V @ 12A or 24V @ 6A and the FPO250 will provide 12V @ 20A or 24V @ 10A. The output voltage is selectable by the slide switch in the upper right corner of the unit. Either unit will charge 4 to 80 Ah of battery capacity.

Voltage from this device is available throughout the system from the C8/M8 lock control boards and the D8 power distribution boards.

AC and System Fault output relays of the FPO are wired to the VERTX hardware, and a fire alarm interface is available for lock over ride in the event of a fire condition. The fire over ride is applied to the C8/M8 lock control boards as needed and programmed.

See the supplied FPO manual for more information.

Typical Wiring - FPO75

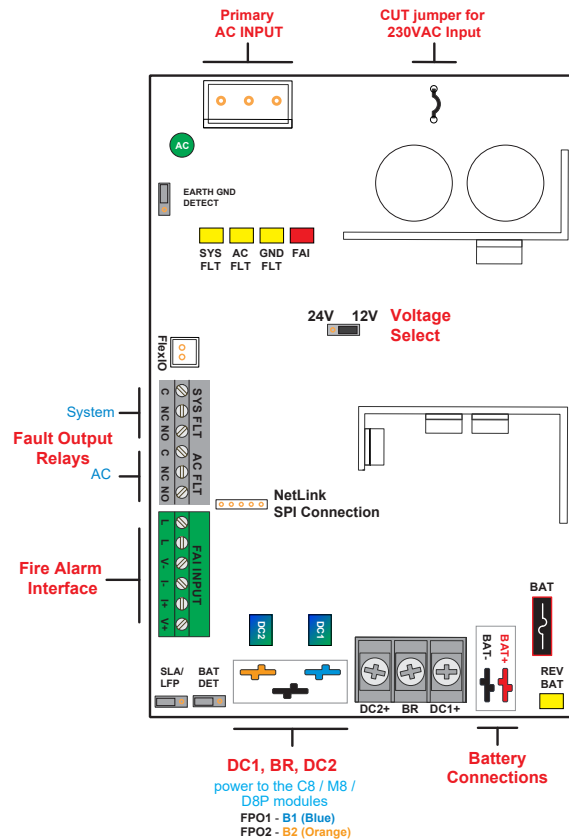

The FPO75 will provide 12V @ 6A or 24V @ 3A. The output voltage is selectable by the two position jumper in the center of the unit. The FPO75 will charge 4 to 40 Ah of battery capacity.


Voltage from this device is available throughout the system from the C8/M8 lock control boards and the D8P power distribution boards.

AC and System Fault output relays of the FPO are wired to the VERTX hardware, and a fire alarm interface is available for lock over ride in the event of a fire condition. The fire over ride is applied to the C8/M8 lock control boards as needed and programmed.

See the supplied FPO manual for more information.



Typical Wiring - B100

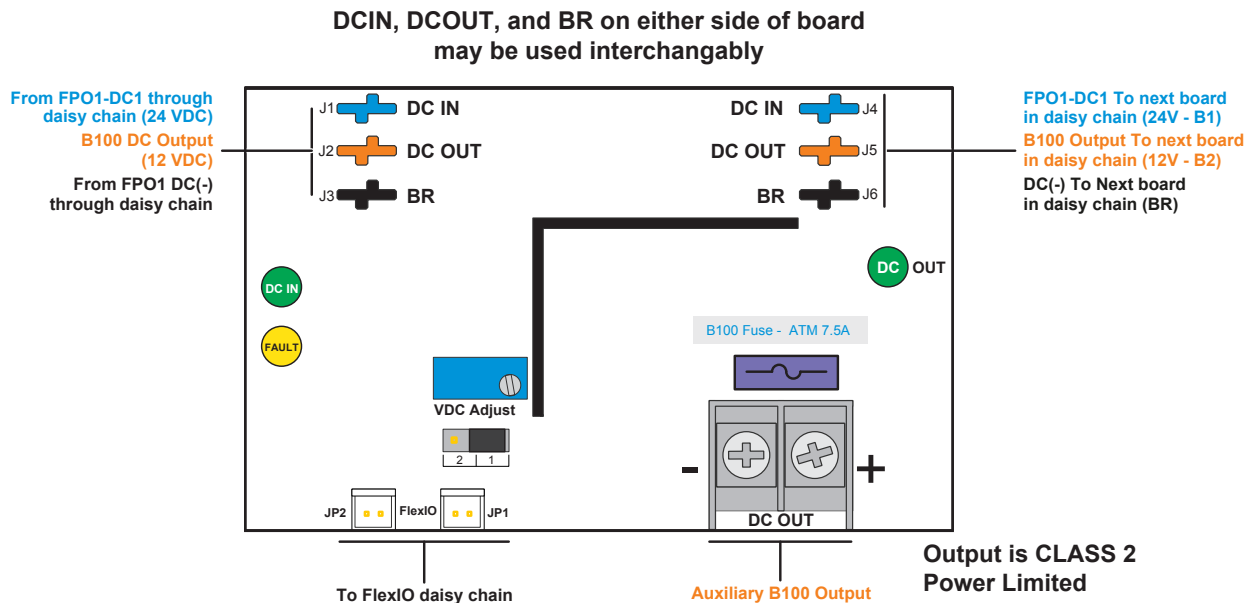

The B100 is used to provide 12V system power when the necessary current is less than 4A. The advantages of using the B100 over an FPO are that the B100 is physically smaller for more effective space utilization, more economical, and does not require a separate standby battery for 12V backup. Input power for the B100 is derived from FPO-1, which is set for 24V, rather than the AC line.


The B100 provides onboard visual indication of an operational or output fault and will transmit that fault condition to the host FPO in the system for activation of the FPO system fault relay. A system fault alert will be provided by the NL4 if installed in the system.

The B100 is rated as a Low Voltage, Class 2, power Limited unit.

For more information, see the provided B100 manual and Application Note AN-07.



Typical Wiring - D8

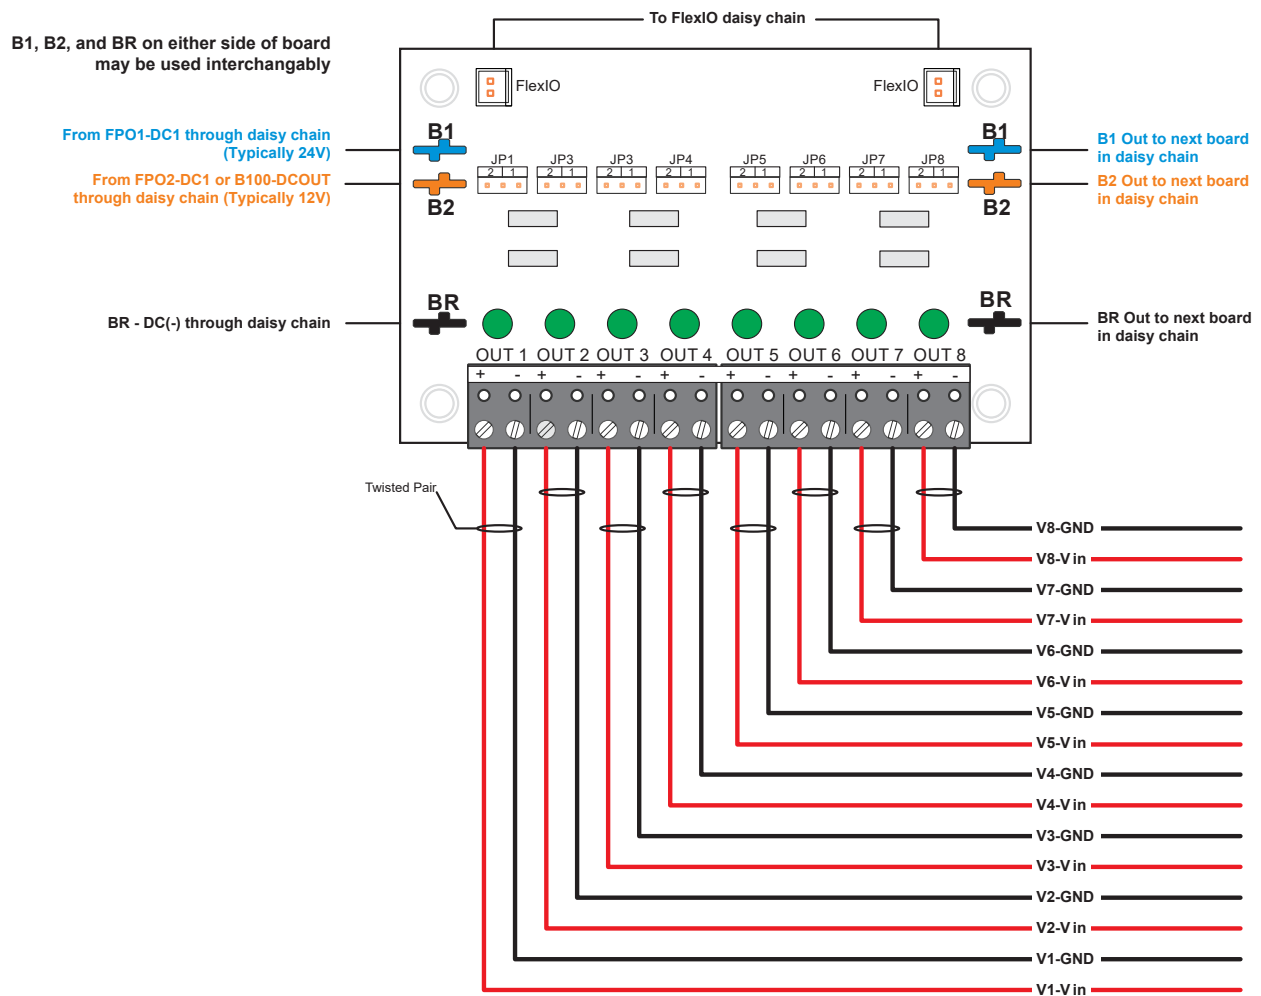

The D8 provides continuous auxiliary outputs. D8-1 is prewired for power to the VERTX controllers. One or more additional D8 boards may be provided for external auxiliary power. The terminal strips on these additional D8 boards will be empty.


Jumpers JP1 through JP8 are used to select the output voltage for each output in dual voltage systems. Position 1 selects the voltage connected to the B1 buss, while position 2 selects the voltage on the B2 buss. Single voltage systems should leave these jumpers in position 1.

In B100 dual voltage systems, B1 is 24V and B2 is 12V, as set from the factory.

See the D8 manual provided for more information.



Typical Wiring - C8

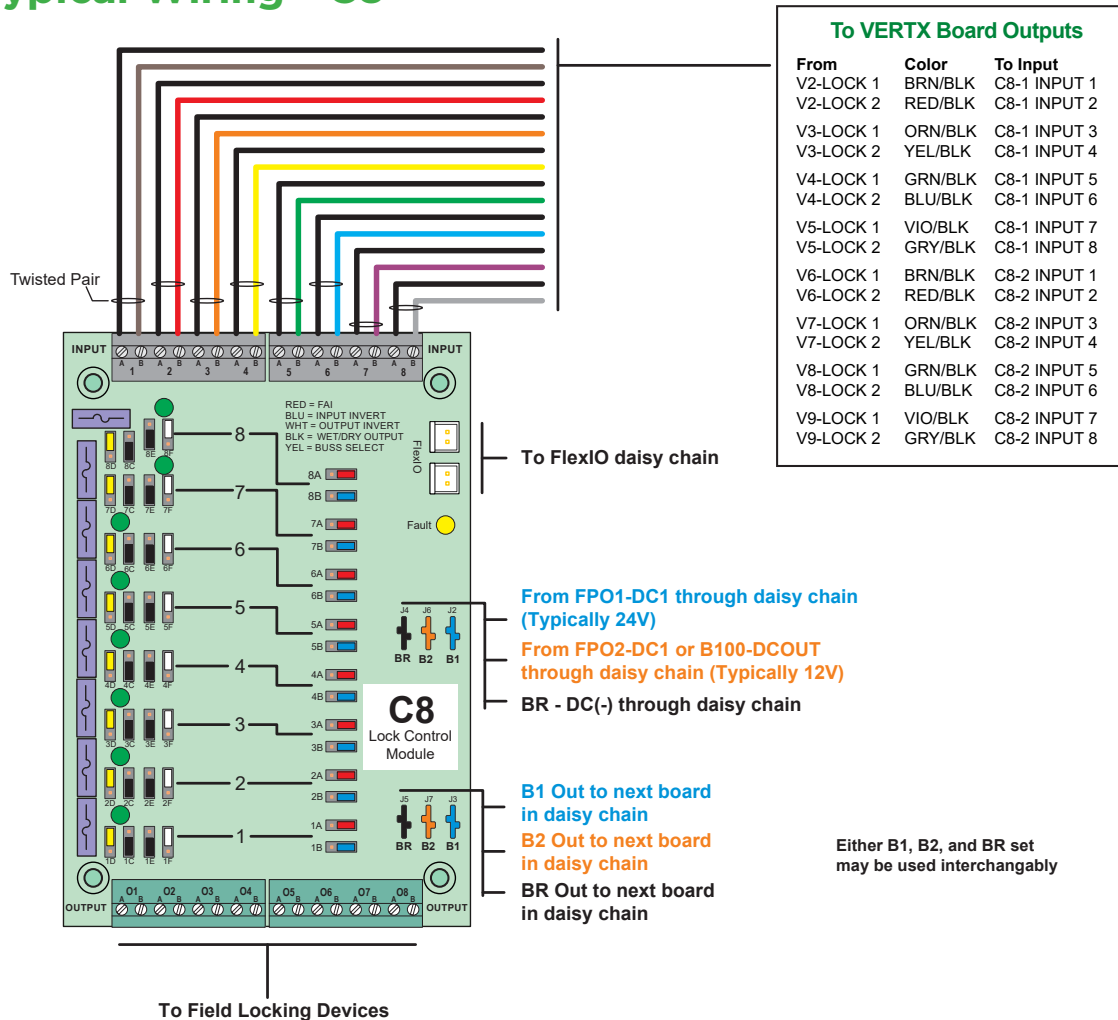

The C8 provides a protective and operational buffer between the access control boards and field induced problems or issues.


Eight trigger inputs are pre-wired to the access control lock outputs with color-coded, twisted-pair wires and eight relay controlled outputs are provided for lock control. Each output is capable of 3A of current and is selectable for either voltage in dual volt-age systems.

The blue and black jumpers are pre-set from the factory. The jumpers below need to be set by the installer. See the included C8 manual and Application Note AN-29 for more information.

Color	Function	Position 1	Position 2
Red	FAI	Enabled	Disabled
Yellow	Voltage Select	B1	B2
White	Lock Type	Maglock (Fail Safe)	Strike (Fail Secure)



Typical Wiring - M8

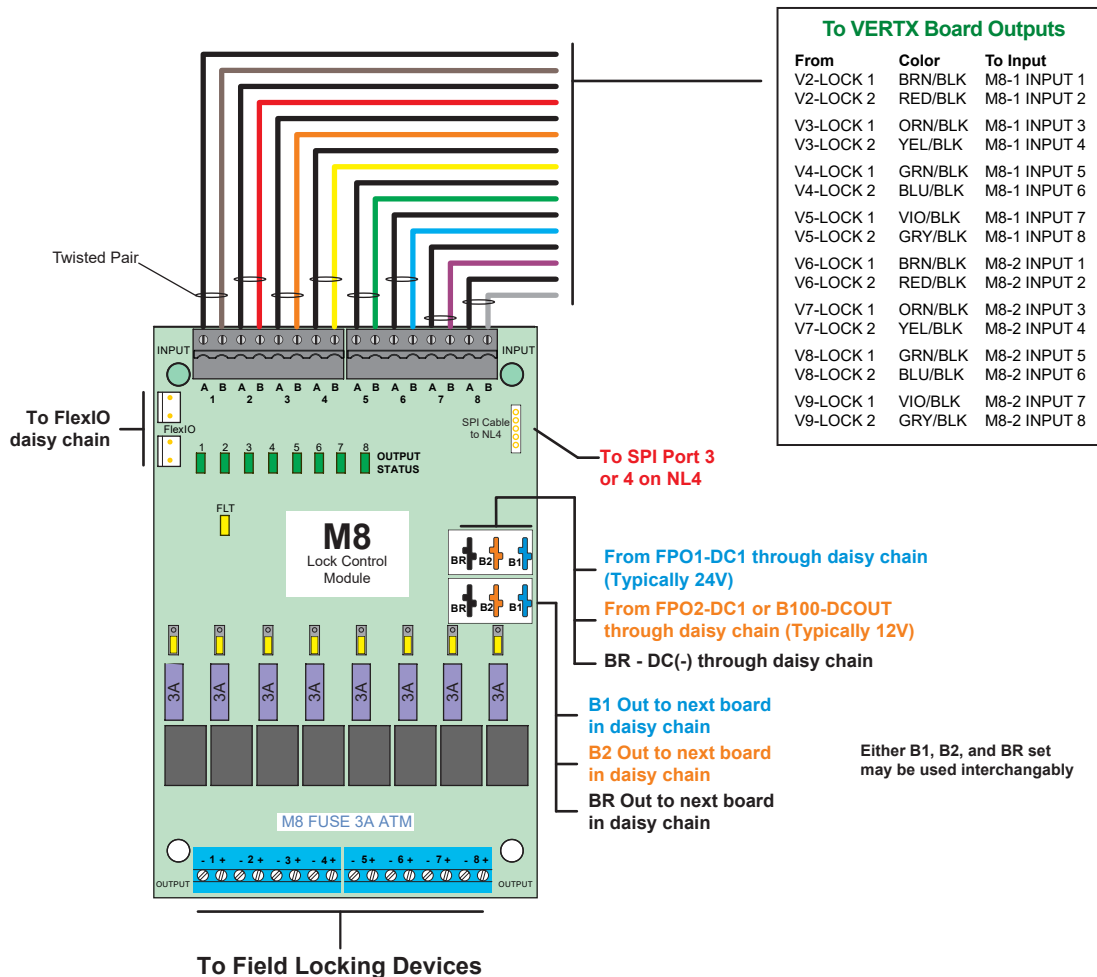


The M8 provides a protective and operational buffer between the access control boards and field induced problems or issues. This unit is used for lock control when a network managed system is desired with remote control, reporting, and diagnostics.

Eight trigger inputs are pre-wired to the access control lock outputs with color-coded, twisted-pair wires and eight relay controlled outputs are provided for lock control. Each output is capable of 3A of current and is selectable for either voltage in dual volt-age systems.

System configuration, FAI Operation, and lock operation are selectable through the embedded browser interface of the required NL4. One jumper per zone is provided for voltage selection in dual voltage systems. See the included M8 and NL4 manuals for more information.

Typical Wiring - NL4

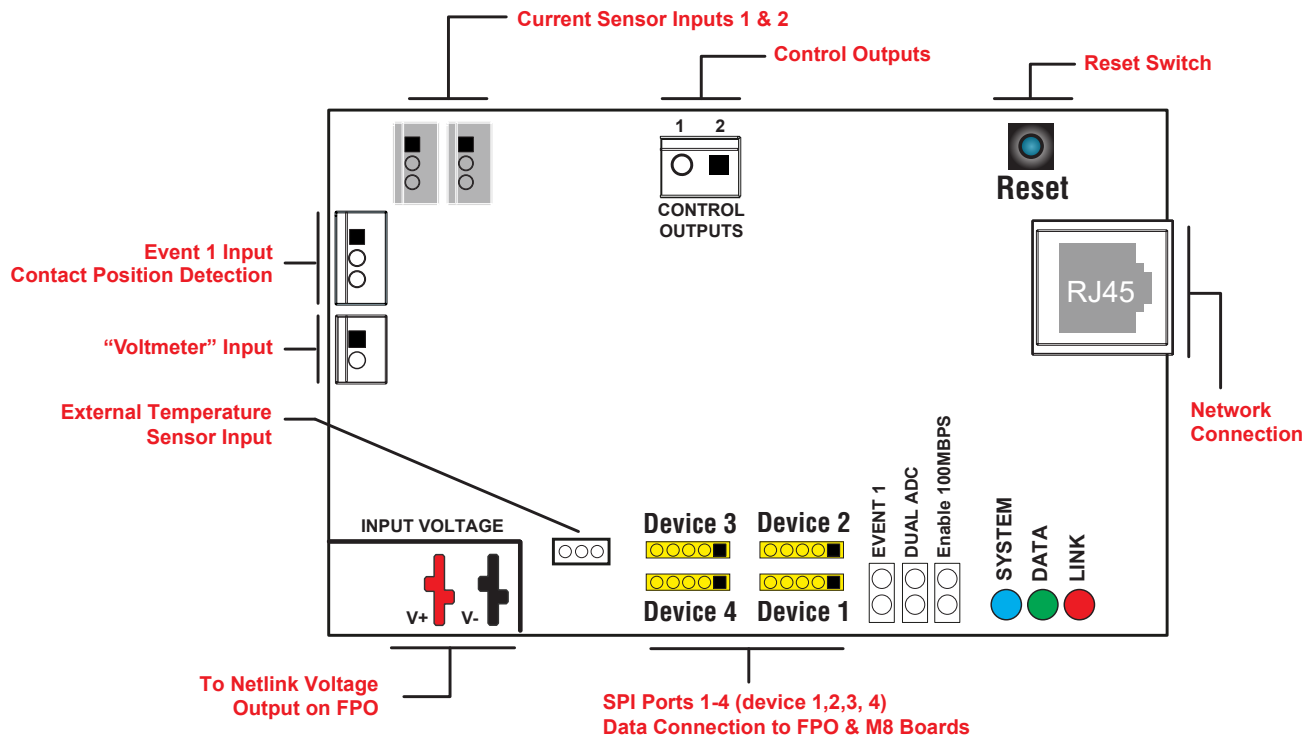

The NL4 is a network module that allows status communication and power control over a local or wide area network. The NL4 provides four device ports for connection to other FlexPower devices. Data monitored includes fault status, power supply output voltage, battery voltage and charging current, and FAI status. When used with an M8 output board, the NL4 allows control of each individual output, along with the ability to view voltage and current for each output.

In addition to the four device ports, the NL4 also includes two current sensors, a voltmeter input, an external temperature sensor, and a contact monitor input. Upper and lower limits can be set for these inputs to provide an alert if the sensor goes out of range.

A 1000 point history data log updates at the selected interval and is emailed on a status change. The data log can also be set to send on a selected schedule.

See the provided NL4 manual and Application notes AN-20, AN-23, AN-24, and AN-25.



Power is knowledge.™

LifeSafetyPower®

LSP /
HID VERTX
PROWIRE®

This Page Intentionally Blank



Power is knowledge.™

LifeSafety Power®

LSP /
HID VERTX
PROWIRE®

For more information about the ProWire™ System:
www.lifesafetypower.com
PH 888.577.2898

© 2021 LifeSafety Power. All rights reserved. LifeSafety Power, FlexPower and ProWire are registered trademarks of LifeSafety Power or its affiliates. Product specifications are subject to change without notice. This material is provided for informational purposes only; LifeSafety Power assumes no liability related to its use.